


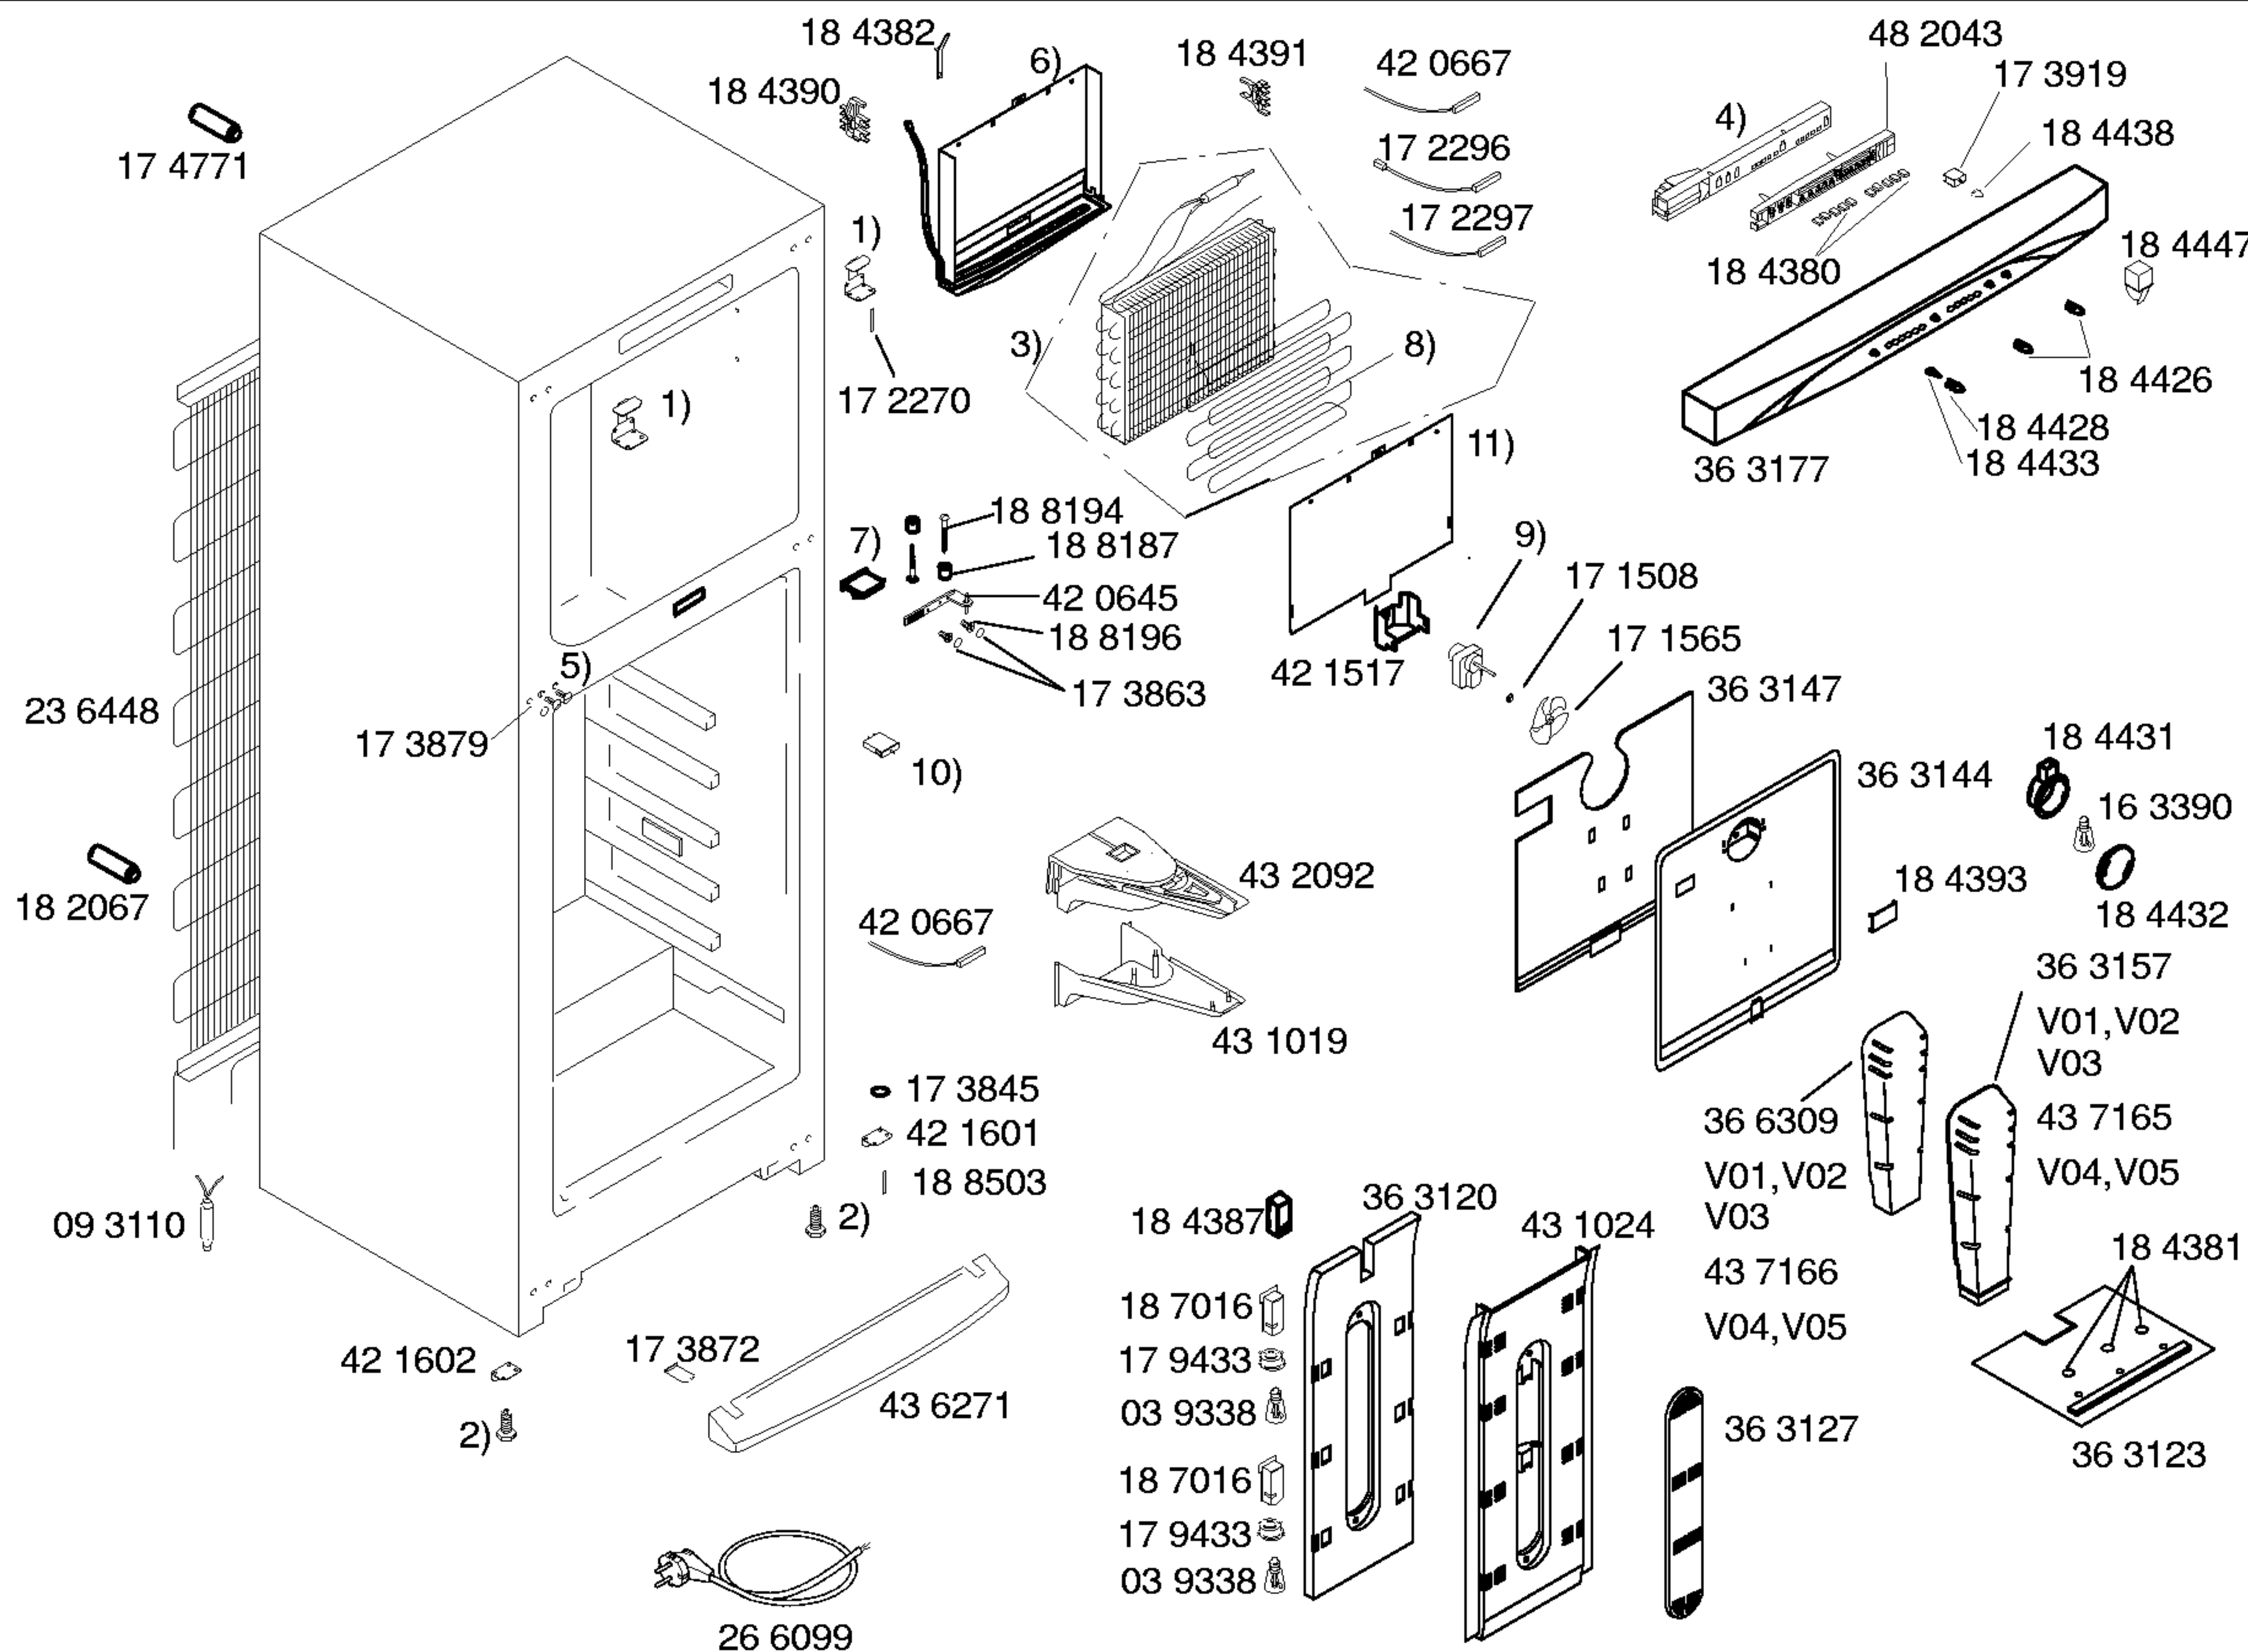

Mat. – Nr. – Konstante
3740

Gebrauchsanweisung 58 7169

- 1) 17 1312
2) 18 9089
3) 36 9815

V01,V02,V03,V04

43 8726

V05

- 4) 48 9131

- 5) 17 3866

- 6) 36 9905

- 7) 41 8169

- 8) 36 9816

V01,V02,V03,V04

- 9) 49 0859

- 10) 17 3846


V01

42 2741

V02,V03,V04,V05


- 11) 36 6902

V01,V02,V03,V04

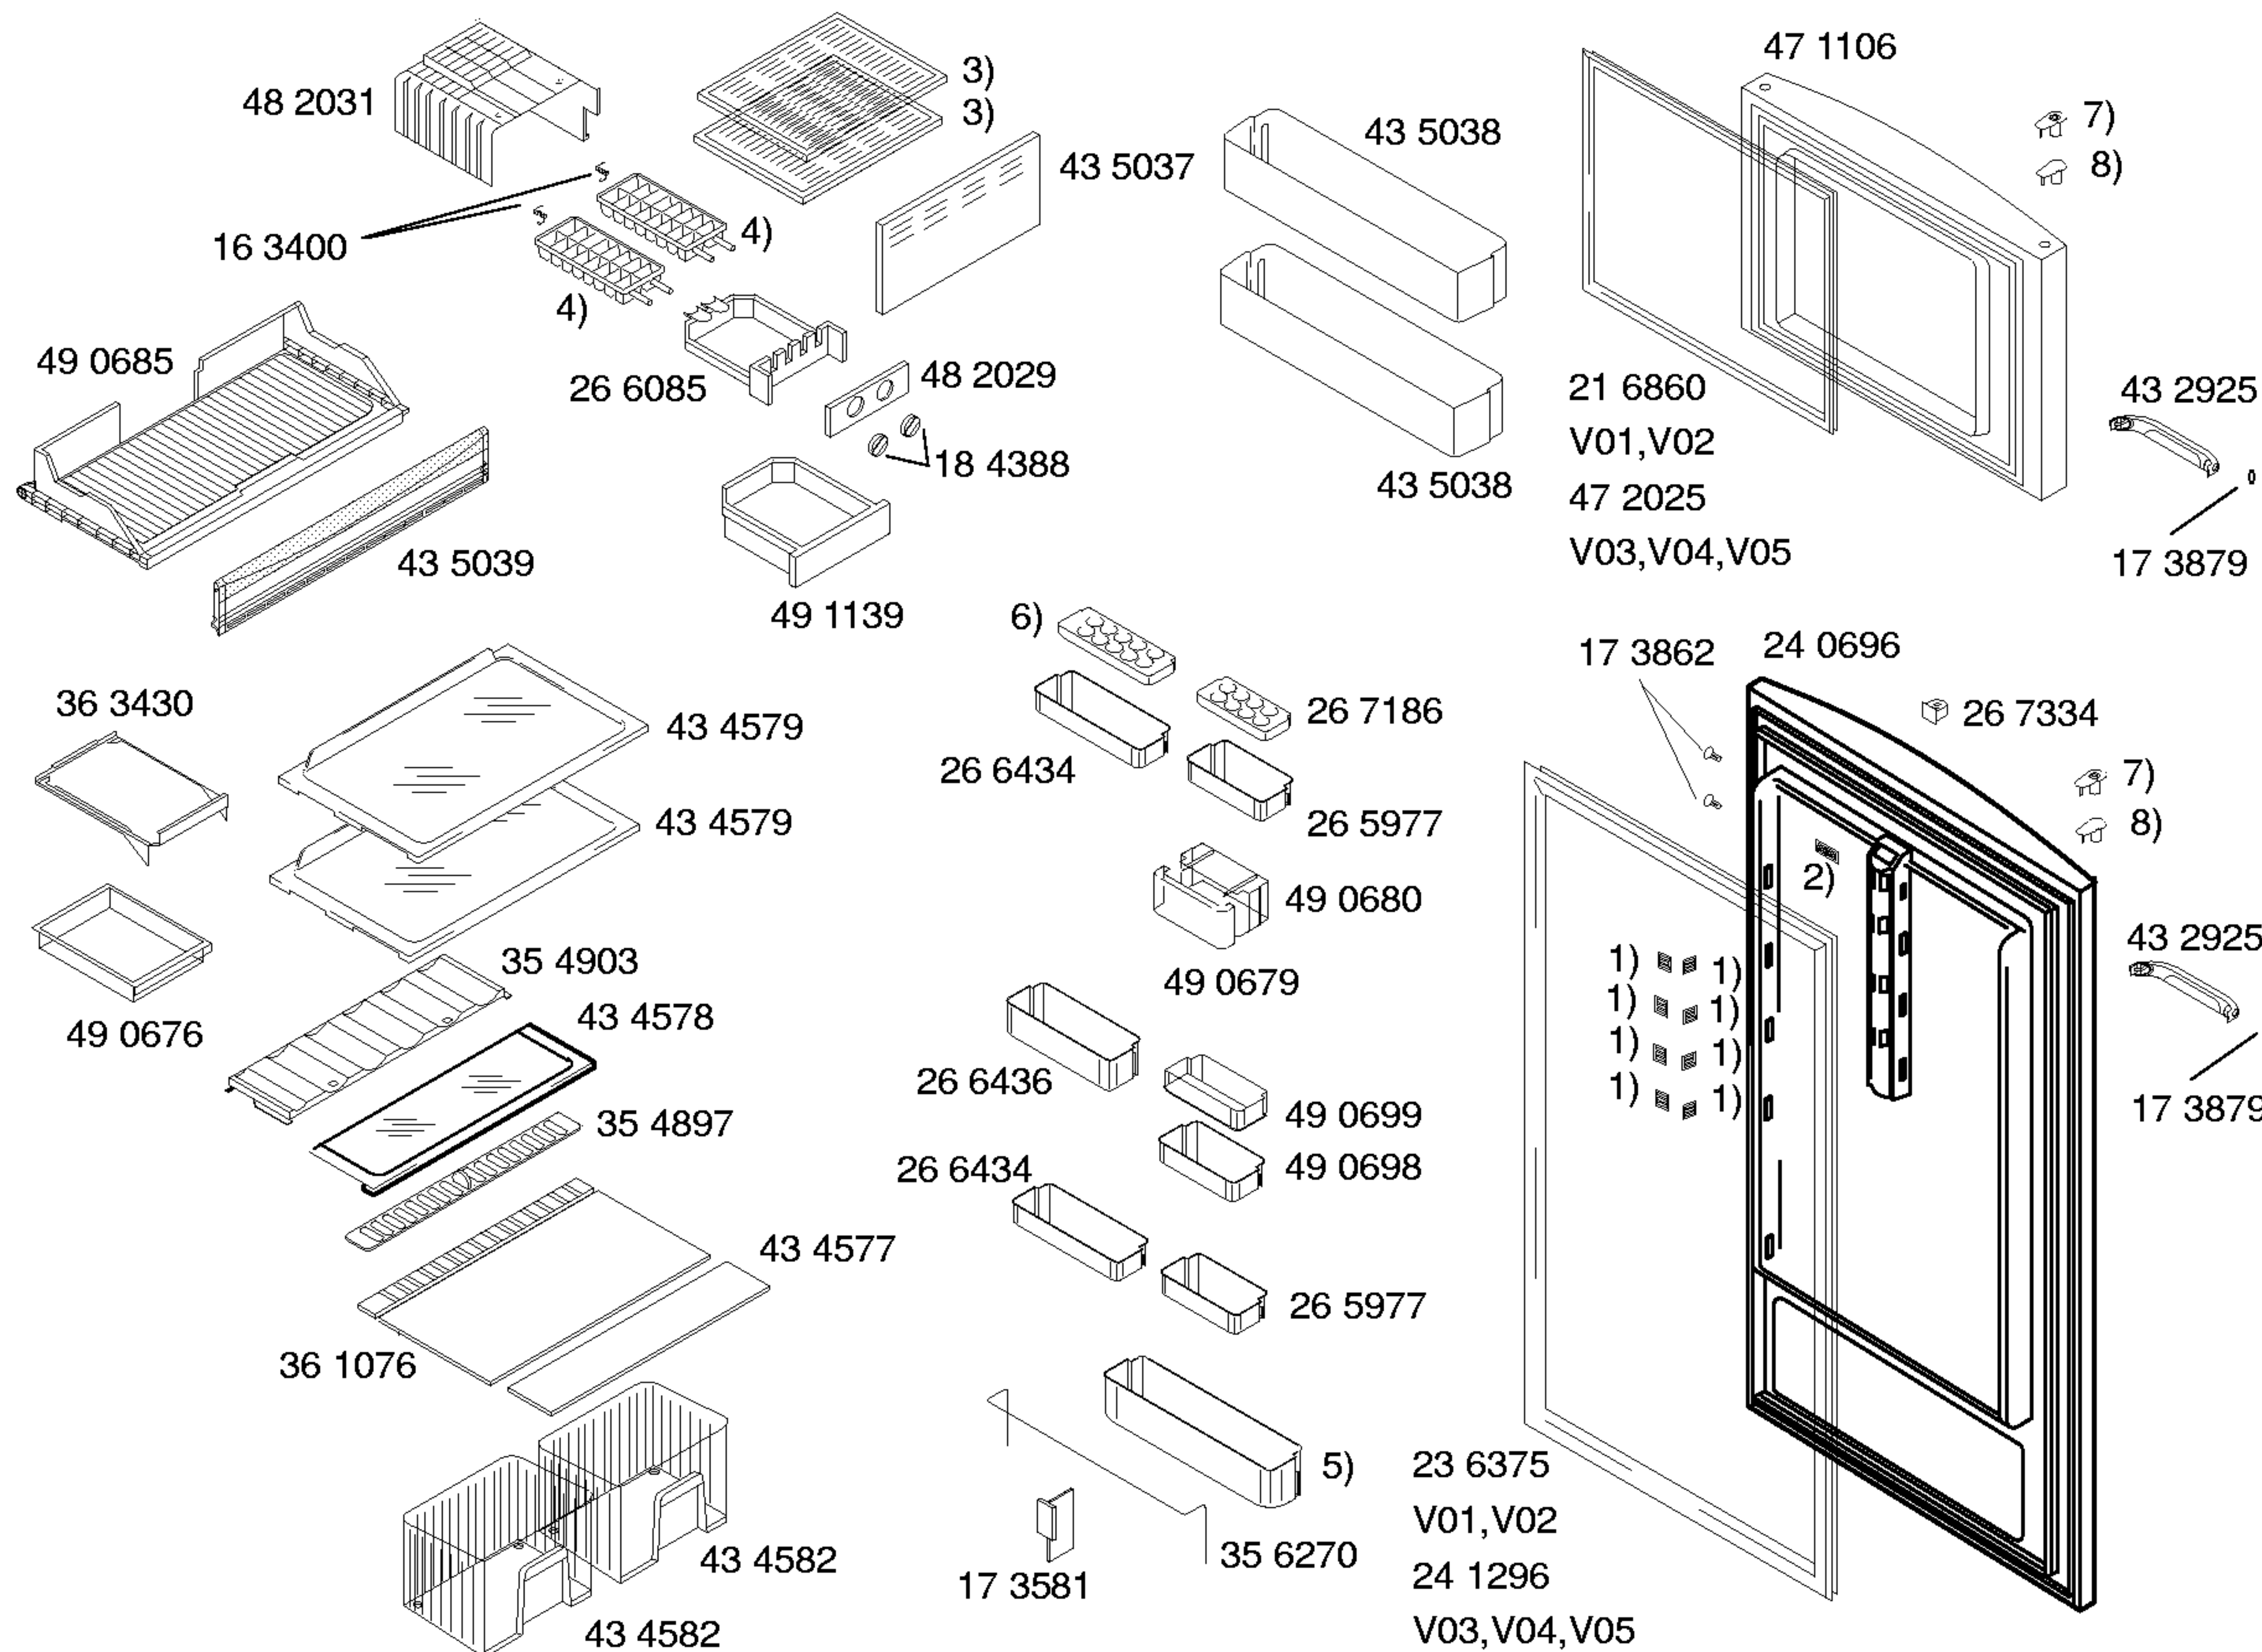

Mat. - Nr. - Konstante
3740

- 1) 41 6843
- 2) 41 6844
- 3) 49 0872
- 4) 26 9013
- 5) 35 6269
- 6) 26 7198
- 7) 17 3851
- 8) 17 3857
- 9) 43 4579

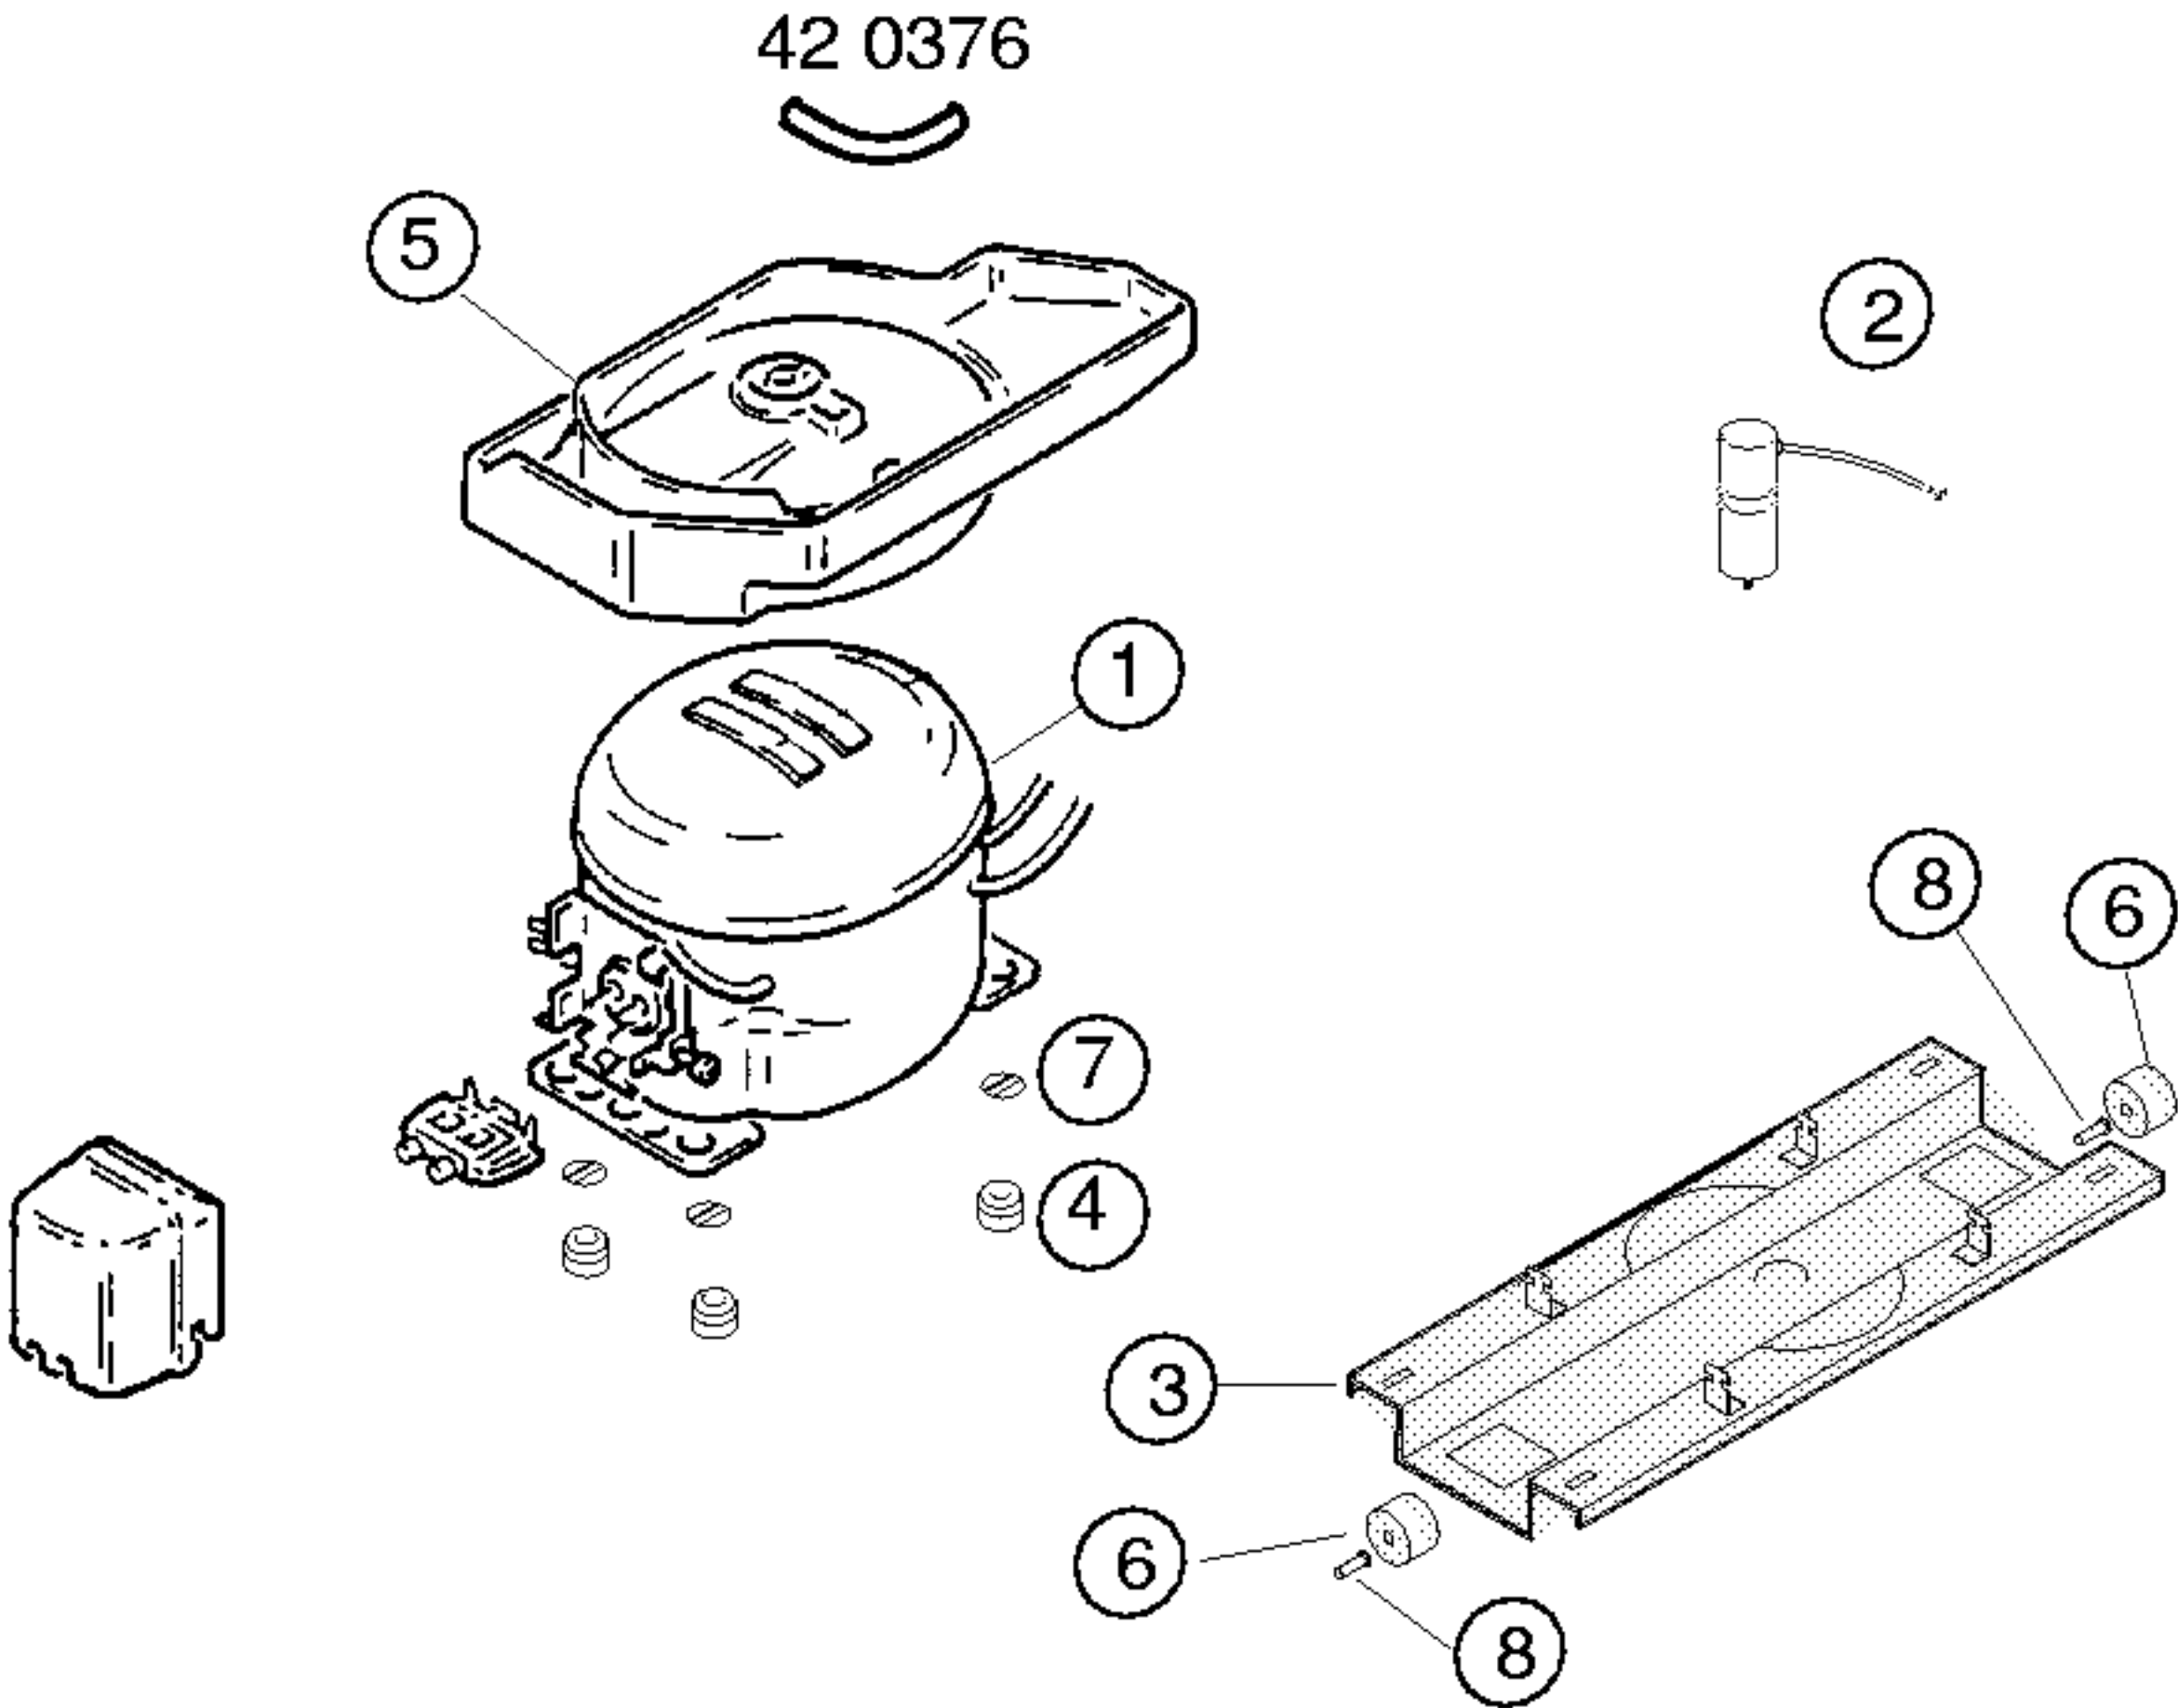

Pos.	Mats.		
	DGX125E		
1	14 3603		
2	42 0827		
3	35 4583		
4	16 3427		
5	49 1245		
6	17 1318		
7	17 1519		
8	18 1014		
9			
10			
11			
12			

TECHNISCHE DATEN/TECHNICAL DATA/TEKNIK BİLGİLER				
Verdichter/Compressor/Kompresör Typ/Type/Tip Förderleistung/Delivery/Verim/h Anlaufstrom/Starting current/Giris akimi Widerstand/Resistance/Rezistans Ha/ Hi/aux.	Danfoss NLE15KTK 8 A Ω			
Temp.Reyler/Thermostat/Termostat Typ/Type/Tip Reglerstellung/Position/Termostat pozisyonu Schaltwerte/Acma kapama degerleri Valeurs de commutation/Termostat degeri (..abtaven' od)	Elektronisch ..ein/acma °C ..aus"/kapama ..alarm'			
Füllmenge/Fill. quantily/ Dolum miktari	R600	g	60	
Anschlusswert/Comm. load/Giris gucu	W	215		
Heizung/Heater/Rezistans Widerstand/Resistance/Direnc Leistung/Power/Guc	Ω W	Verdampfer 267	Ablaufrinne 81	Klappe 4
Ventilador/Blower/Vantilatör Widerstand/Resistance/Rezistans	Ω			
Magnetventil/Magnetic valve/Manyetik valf Widerstand/Resistance/Rezistans Spannung/Voltage/Gerilim	Ω V			
Temp.Reyler/Thermostat/Termostat				

* Siehe Typenschild/Mamul etiketine bakiniz