





Mat. – Nr. – Konstante
3740
Gebrauchsanweisung
59 6365
V01,V02
(DE,GB,ES,PT,IT)
69 0066
V03,V04,V05,V06
(DE,GB,ES,PT,IT,FR
NL)

- 1) 42 4798
- 2) 42 4340
- 3) 43 8726
- 4) 49 3812
- V01
- 49 7504
- V02,V03,V04,V05
- V06
- 5) 17 3865
- 6) 36 9905
- 7) 41 8165
- 8) 42 5515
- 9) 36 9816
- 10) 42 1535
- 11) 42 8184
- 12) 48 9440
- V01

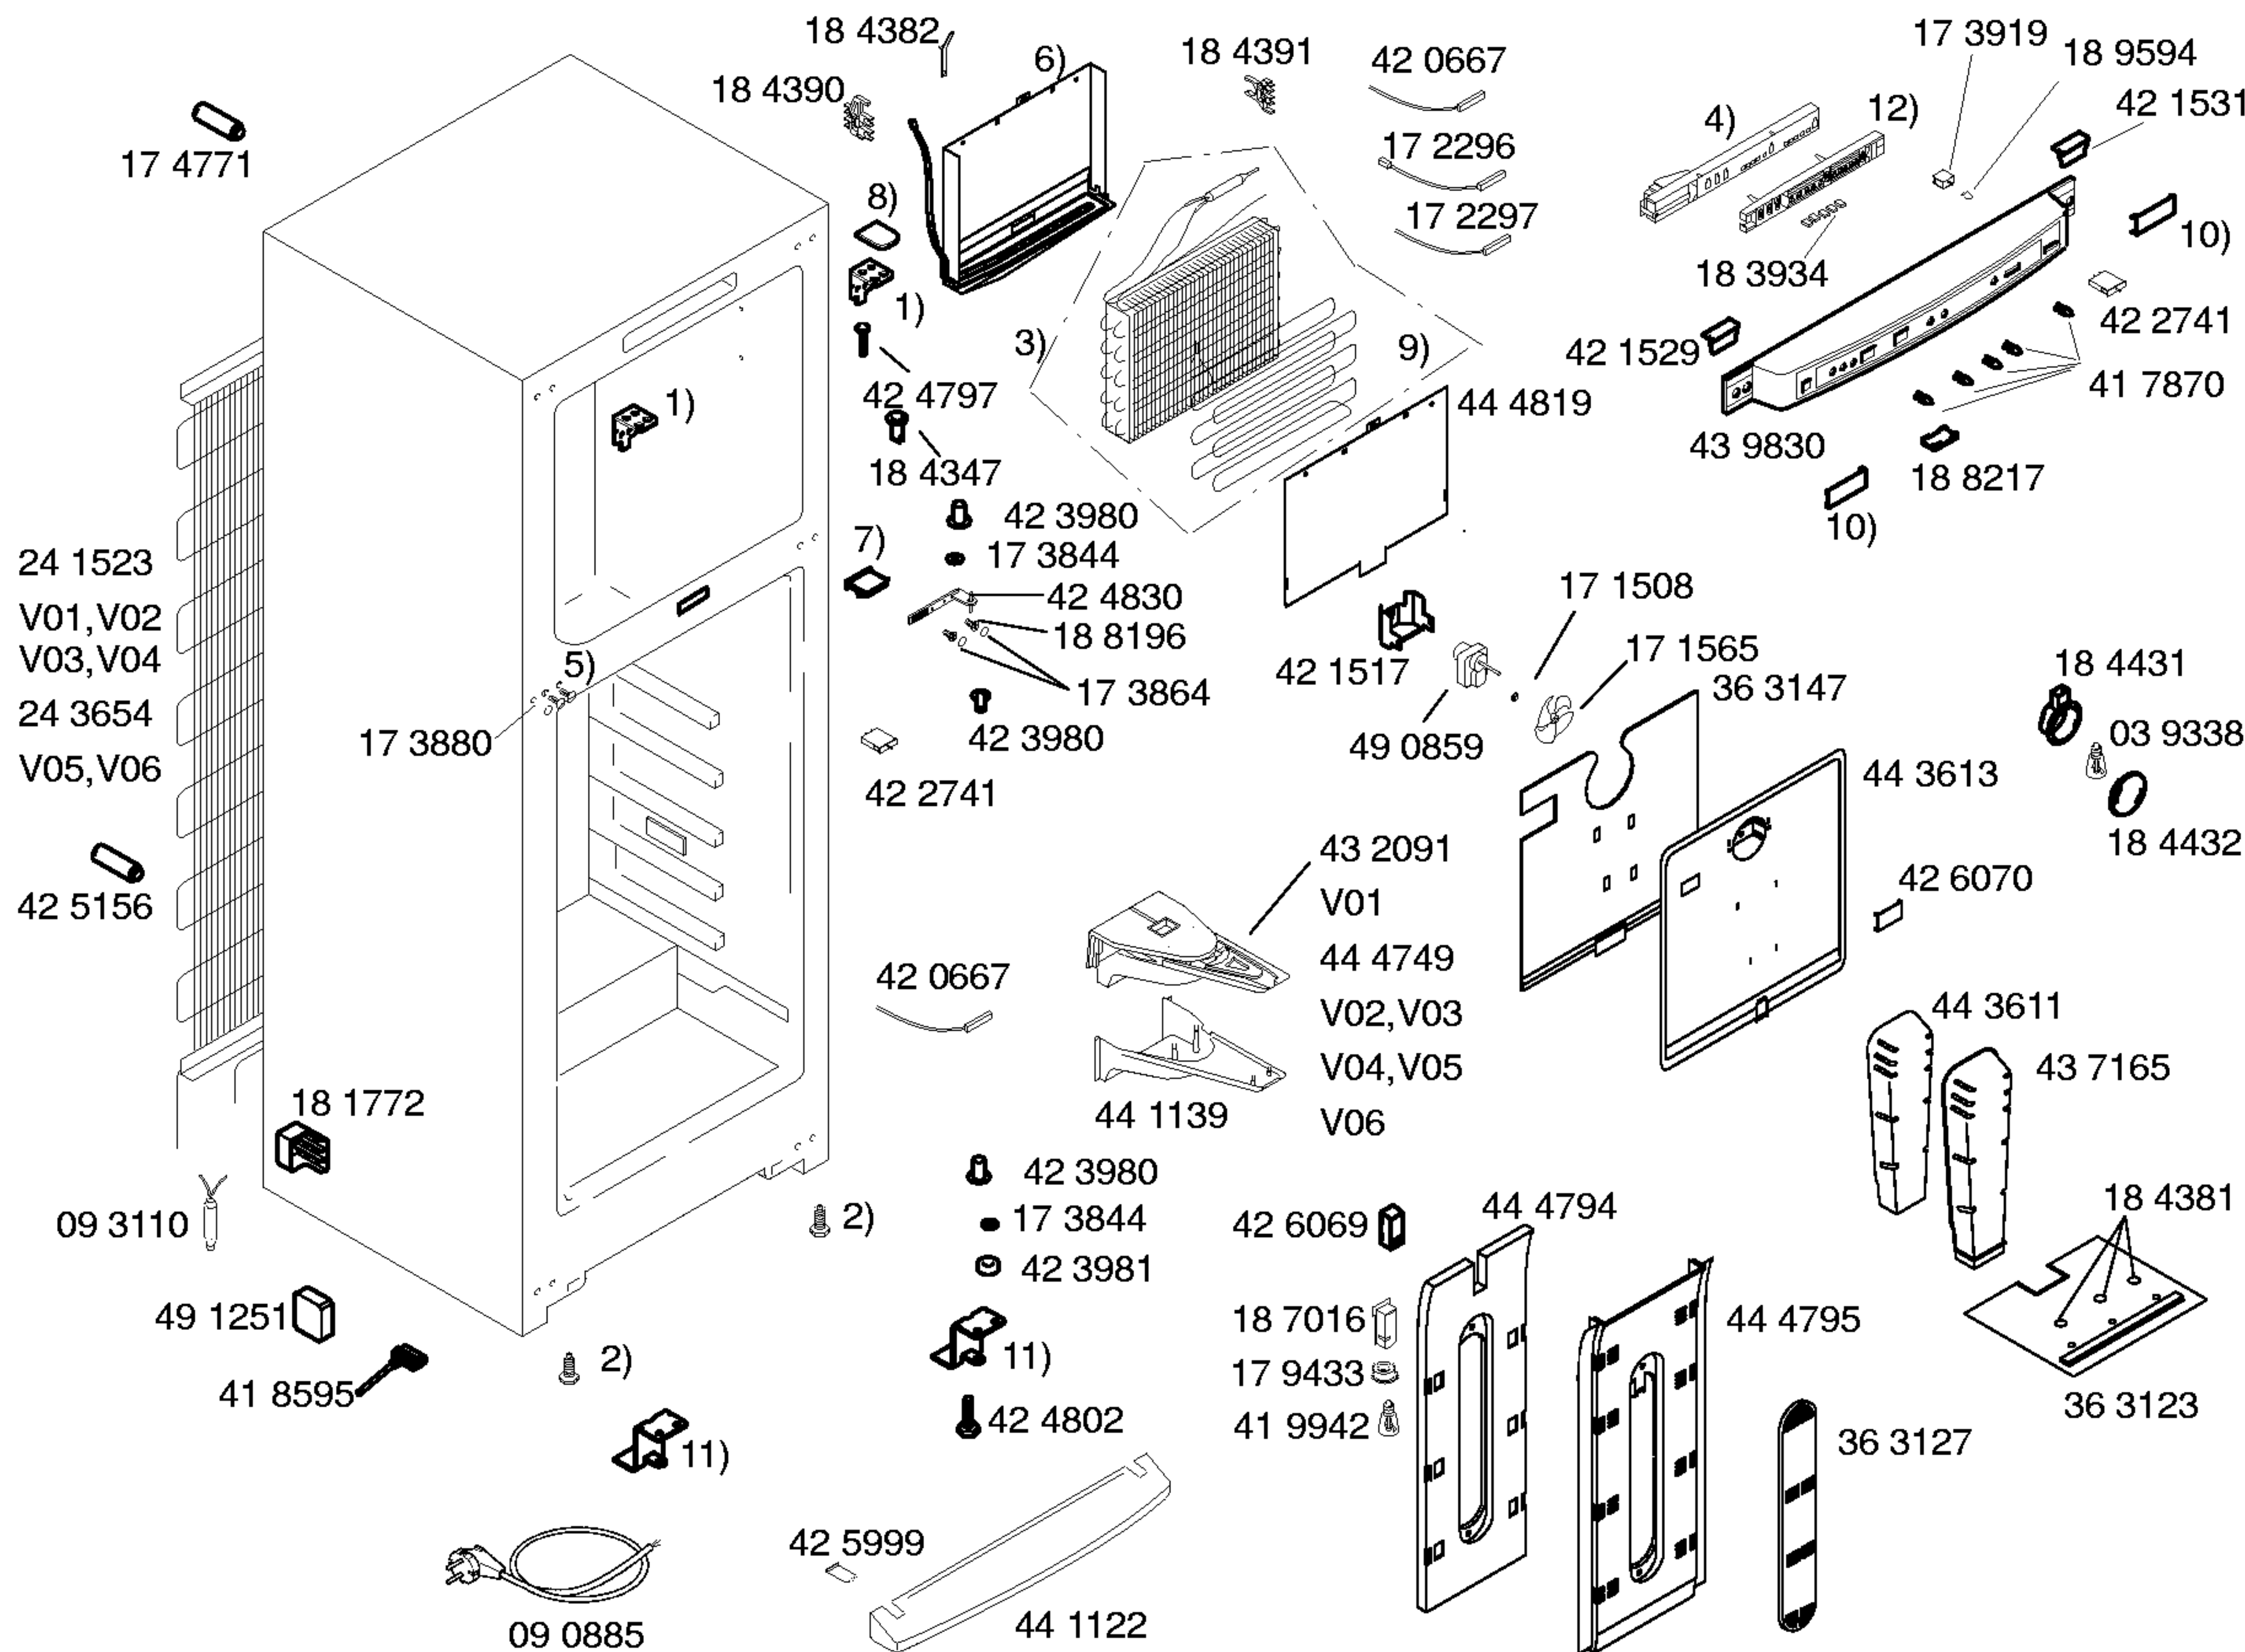

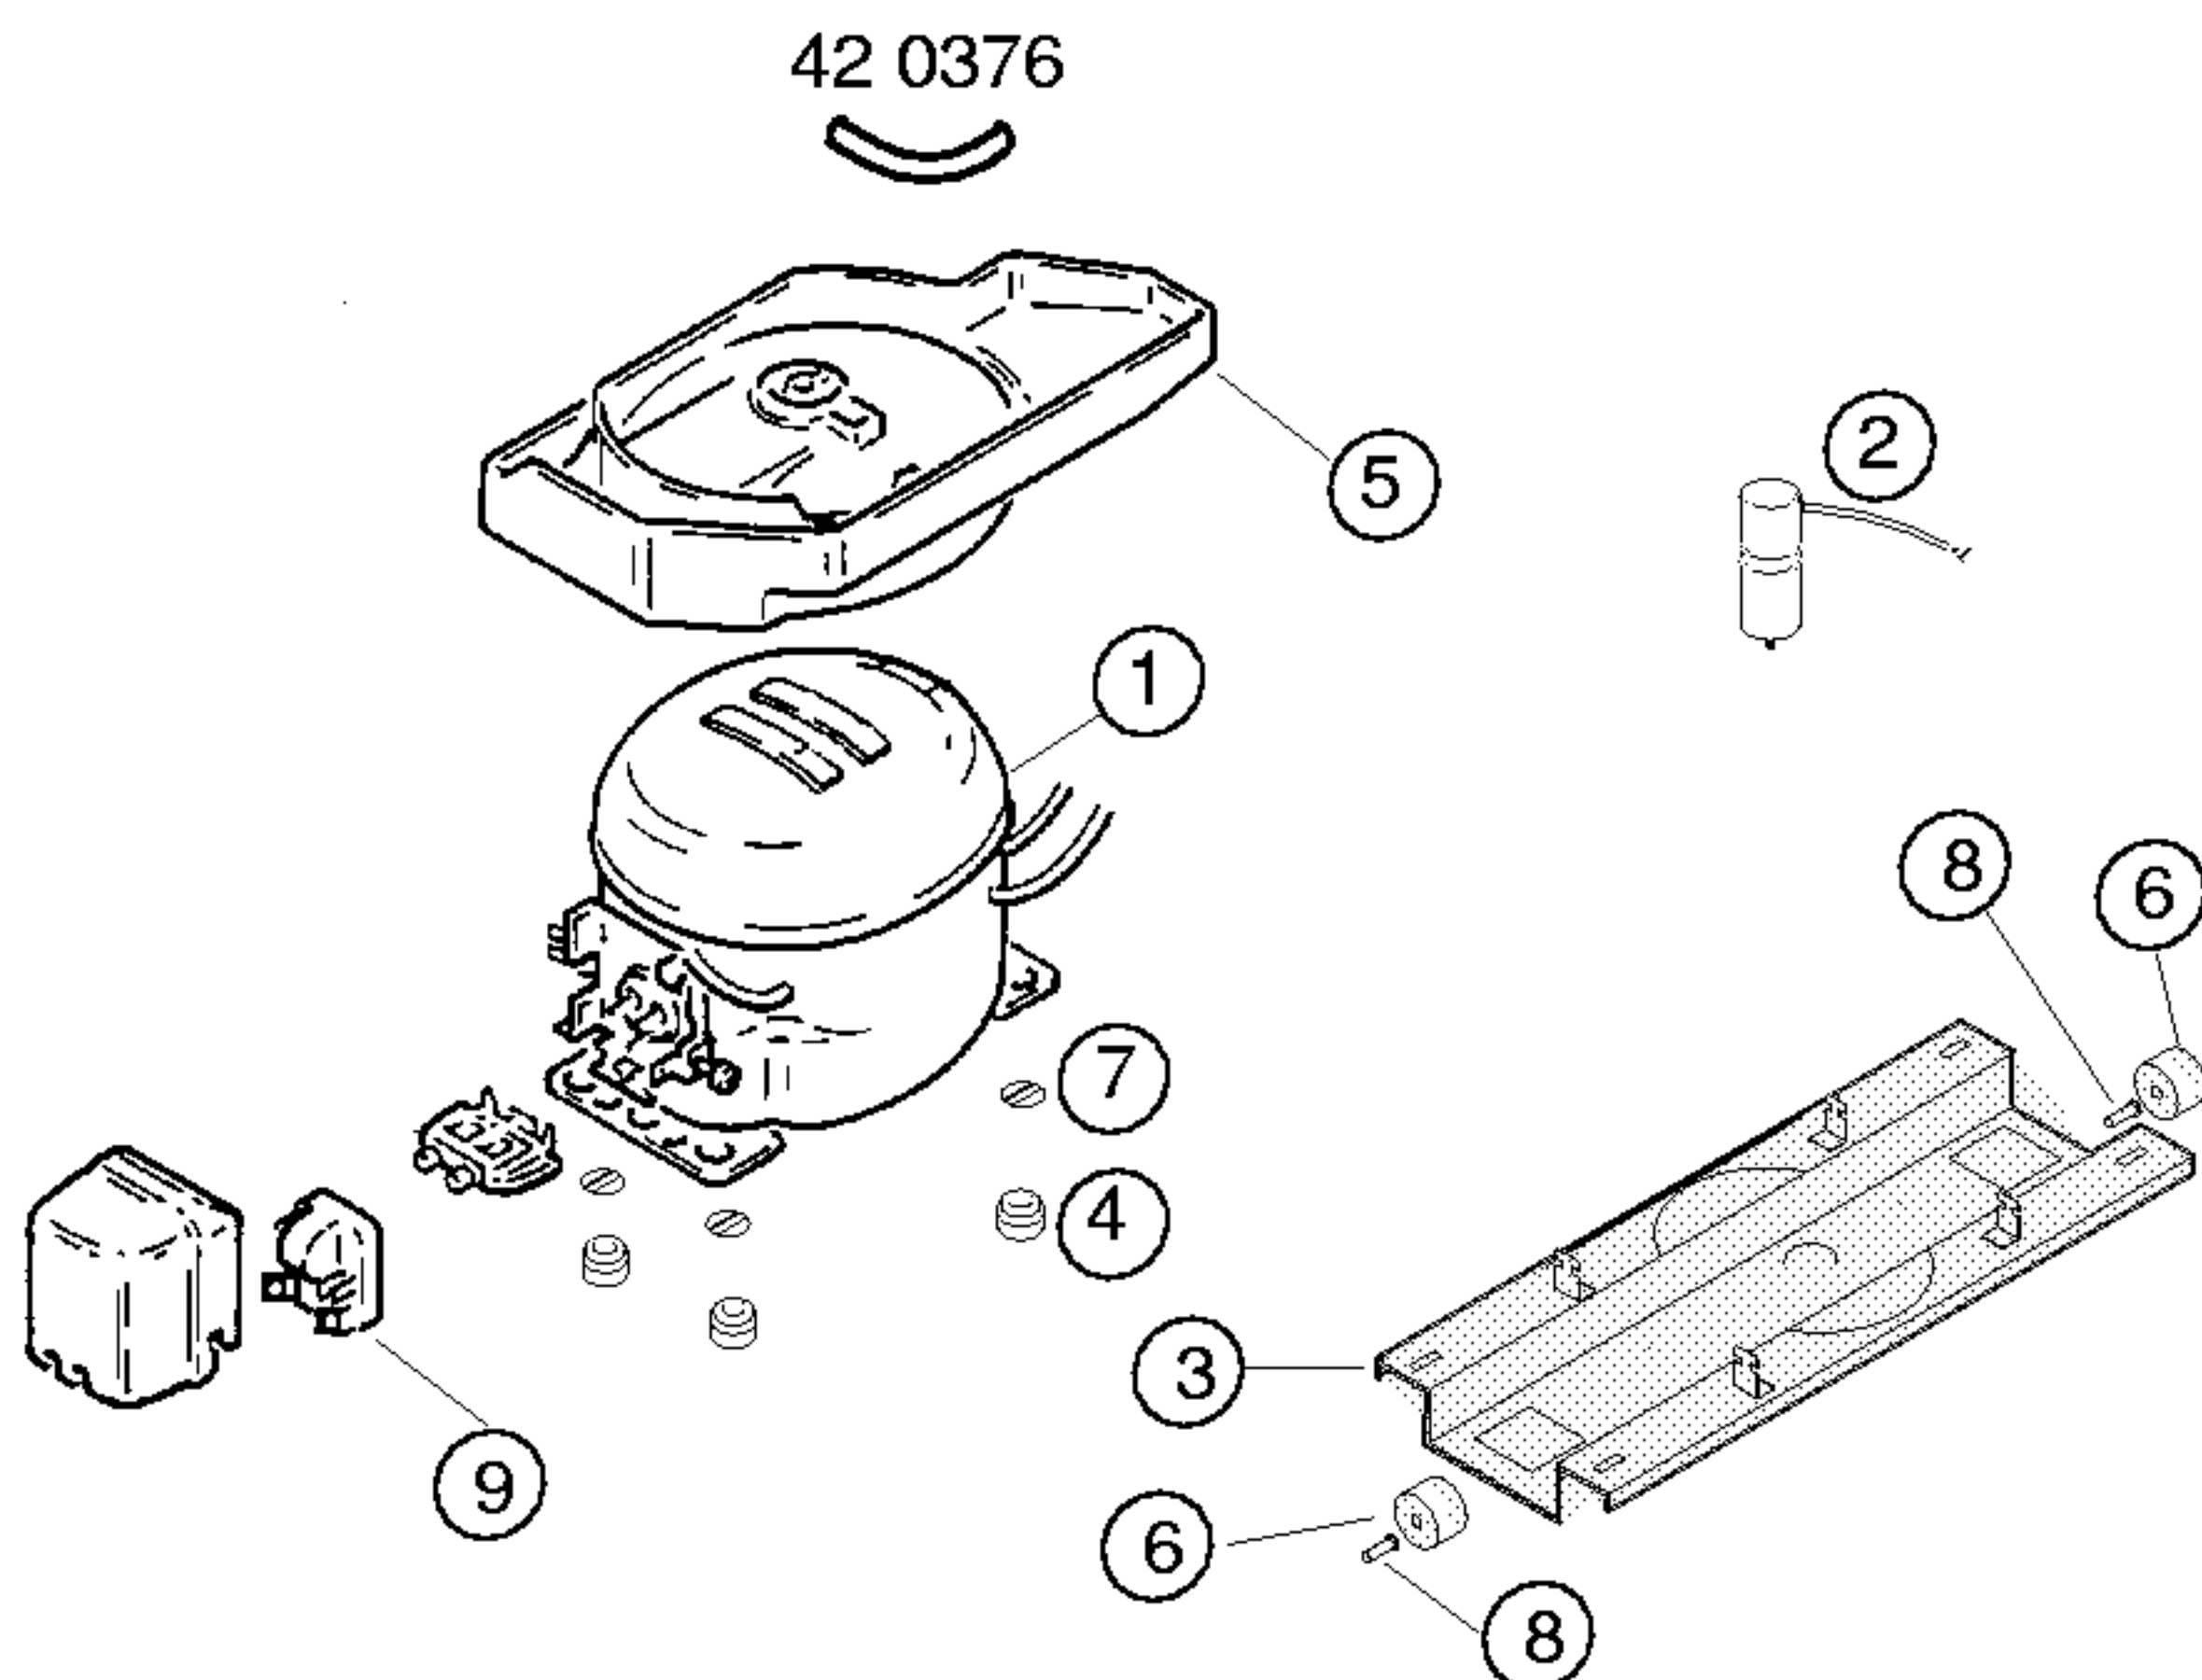

	V01,V02,V03	V04,V05,V06	
Pos.	Matsushita	Danfoss	
	DGX125E	NLX13KK	
1	14 3603	14 4119	
2	42 0857	17 4093	
3	35 4583		
4	16 3427		
5	49 4670	49 4671	
6	17 1318		
7	17 1519		
8	18 1014		
9	—	16 5570	
10			
11			
12			

TECHNISCHE DATEN/TECHNICAL DATA/TEKNIK BILGILER			
	V01,V02,V03	V04,V05	
Verdichter/Compressor/Kompresör	Matsushita	Danfoss	
Typ/Type/Tip	DGX125E	NLX13KK	
Leistung/Power/Guc	W	143	
Anlaufstrom/Starting current/Giris akimi	A	4.4	
Widerstand/Resistance/Rezistans Ha/Hi/aux.	Ω	14.6	
		19.3	
Temp.Reyler/Thermostat/Termostat	Elektronisch		
Typ/Type/Tip			
Reglerstellung/Position/Termostat pozisyonu			
Schaltwerte/Acma kapama degerleri	..ein/acma °C		
Valeurs de commutation/Termostat degeri	..aus"/kapama		
(..abtaven' od)	..alarm'		
Füllmenge/Fill. quantily/ Dolum miktarı	R600 g	58	58
Anschlusswert/Comm. load/Giris gucu	W		
Heizung/Heater/Rezistans	Ω		
Widerstand/Resistance/Direnc	W		
Leistung/Power/Guc			
Ventilador/Blower/Vantilatör	Ω		
Widerstand/Resistance/Rezistans			
Magnetventil/Magnetic valve/Manyetik valf	Ω		
Widerstand/Resistance/Rezistans	V		
Spannung/Voltage/Gerilim			
Temp.Reyler/Thermostat/Termostat			

* Siehe Typenschild/Mamul etiketine bakiniz